




Elektromagnetski razvodnici



Gateway- System EX500

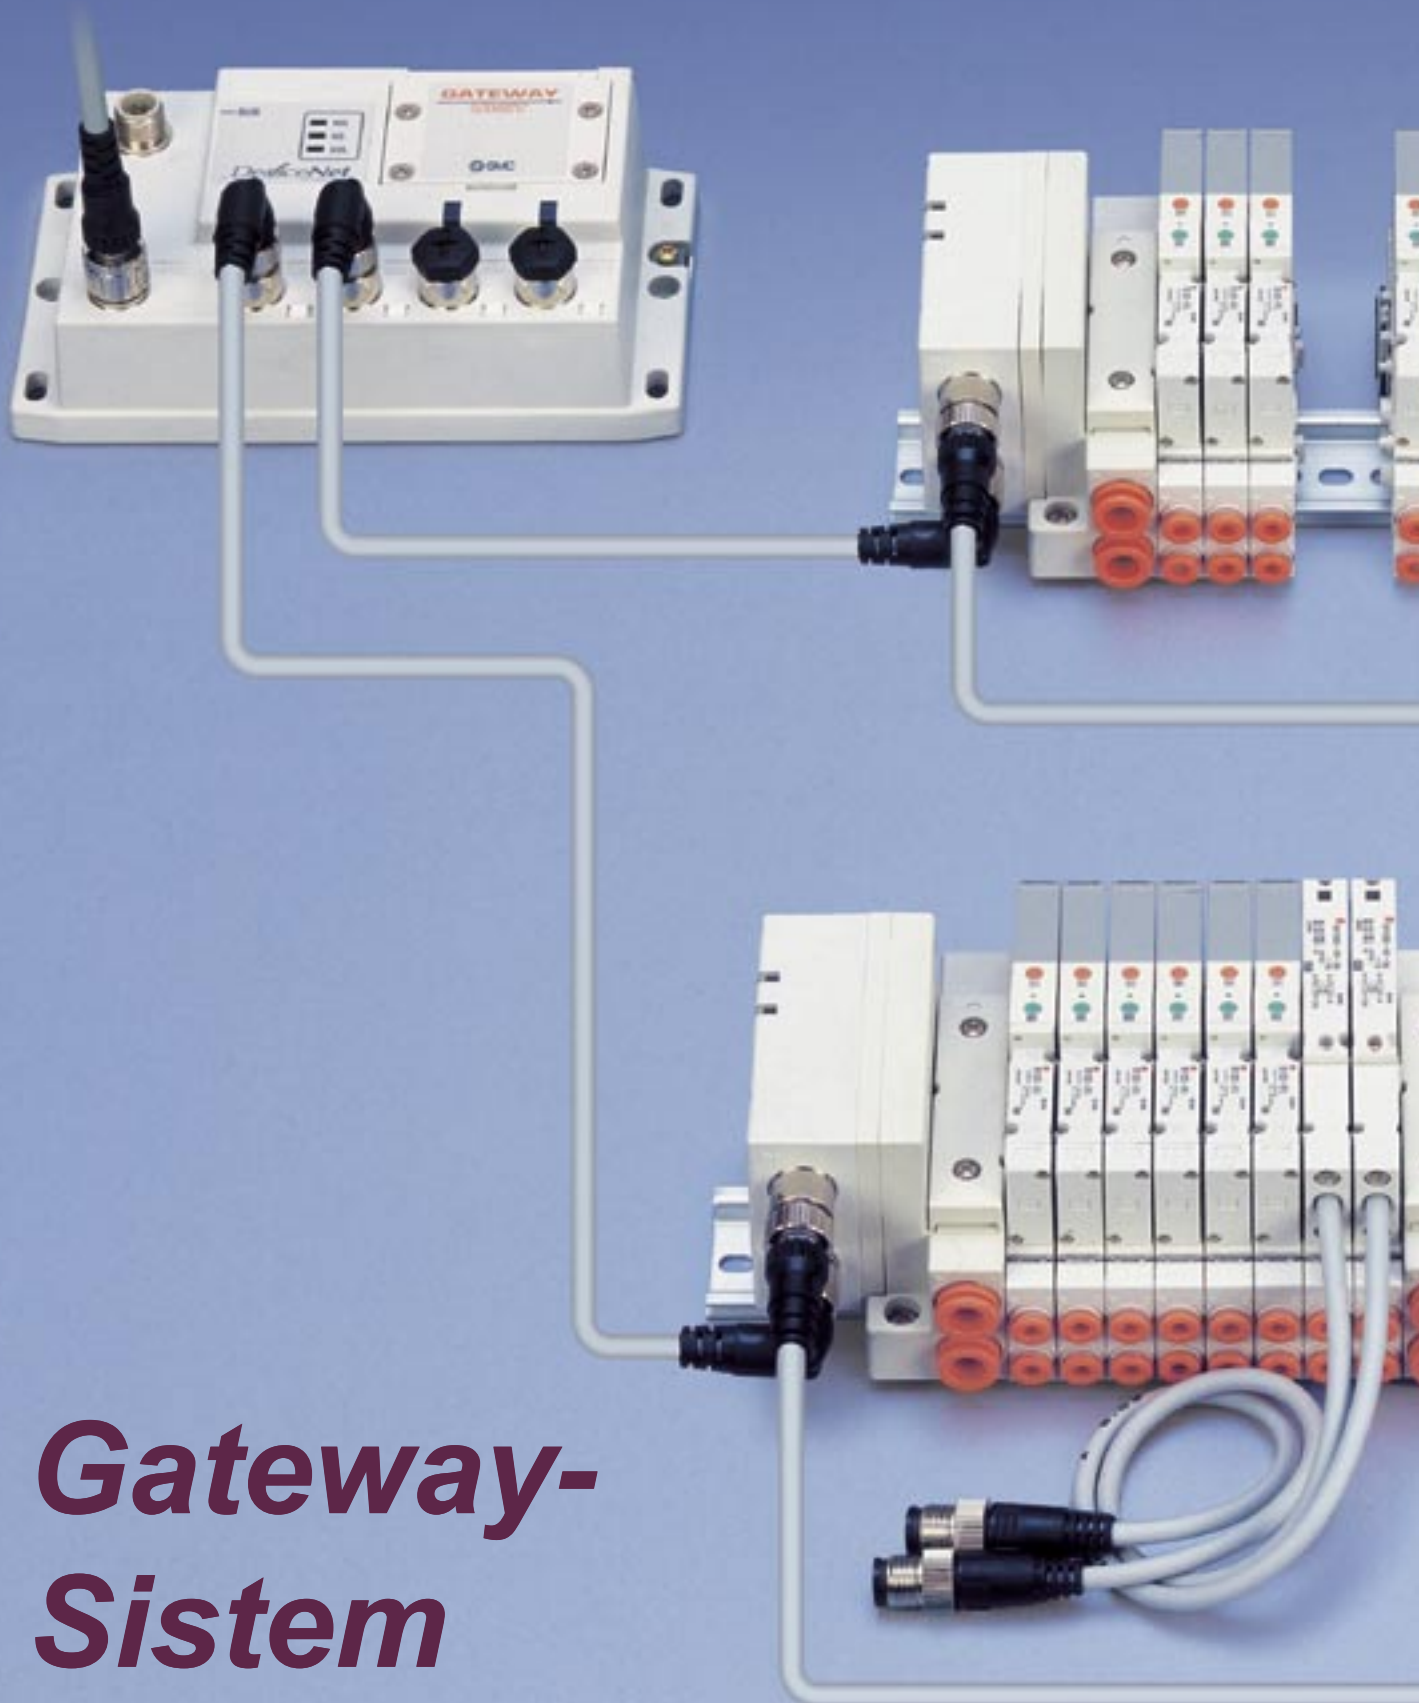

NOVO

nr.	označavanje	kataloška oznaka	broj ulaza	serija	stupanj zaštite
1	ulazna jedinica	EX500-IB1	max. 16	SVVQC	IP65
2	ulazni blok	EX500-IE1	2 (M8)		
3	ulazni blok	EX500-IE3	2 (M12)		
4	ulazni blok	EX500-IE5	8 (M8)		
5	krajnja ploča	EX500-EB1			
6	DIN-letva	VZ1000-11-3-1000			



Pribor

Komunikacioni kabl između Gateway i DeviceNet

kabl L=1 m	kabl L=5 m
EX500-AC010-DN	EX500-AC050-DN


Kabl za povezivanje Gateway-blok razvodnika-ulazna jedinica

	kabl L=0,5 m	kabl L=1 m	kabl L=3 m	kabl L=5 m
ravni	EX500-AC005-SSPS	EX500-AC010-SSPS	EX500-AC030-SSPS	EX500-AC050-SSPS
kutni	EX500-AC005-SAPA	EX500-AC010-SAPA	EX500-AC030-SAPA	EX500-AC050-SAPA

Konektor za napajanje

	kabl L=1 m	kabl L=5 m
ravni	EX500-AP010-S	EX500-AP050-S
kutni	EX500-AP010-A	EX500-AP050-A

Završni konektor ulazne jedinice EX500-AC000-S postoji opcija kada nema ulazne jedinice za blok razvodnika.

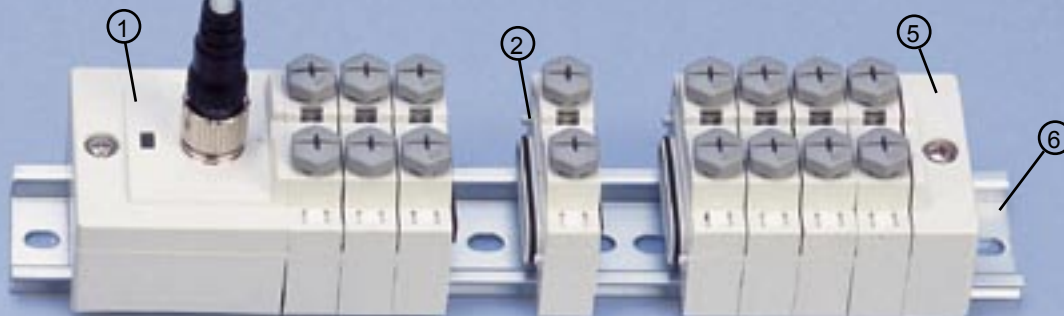

Čepovi za Gateway i ulazni blok

M8 - utičnica	EX500-AWES
M12 - utikač	EX500-AWTP
M12 - utičnica	EX500-AWTS

